


Fig. 93: Floor Plan

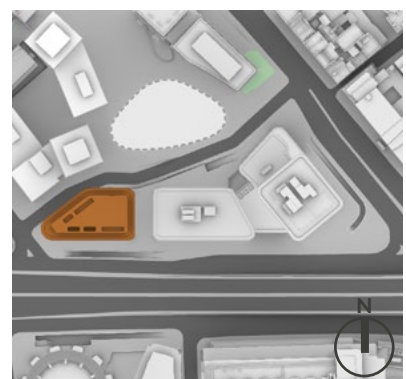

Block I–Level 06

ROOM REF.	ROOM USE	DAYLIGHT							SUNLIGHT		
		EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
BLOCK I - LEVEL 06											
120	BEDROOM	100	100.0			3627			00:00	00:00	01:10
121	BEDROOM	100	100.0			3554			00:00	00:00	01:10
122	BEDROOM	100	100.0			3745			00:00	00:00	01:10
123	L/K/D	200	25.4		35.0	2451	1575	1044	00:00	00:00	01:10
124	BEDROOM	100	4.3			362			00:00	00:00	00:00
125	L/K/D	200	21.2		29.3	2012	1280	922	00:00	00:00	00:00
126	L/K/D	200	7.9		13.0	1304	611	185	00:00	00:00	00:00
127	BEDROOM	100	0.0			13			00:00	00:00	00:00
128	L/K/D	200	40.4		61.2	3005	2478	1950	00:00	00:00	00:00
129	BEDROOM	100	0.0			73			00:00	00:00	00:00
130	BEDROOM	100	0.0			109			00:00	00:00	00:00
131	L/K/D	200	1.3		2.8	1396	907	534	00:06	01:43	01:32
132	BEDROOM	100	26.5			1740			00:01	02:09	02:15
133	L/K/D	200	71.4		89.5	3611	3345	3074	00:55	03:43	07:06
134	L/K/D	200	22.9		29.4	2271	1779	1432	00:34	02:37	05:48
135	BEDROOM	100	100.0			3090			00:23	02:32	05:44
136	L/K/D	200	27.8		34.8	2158	1653	1309	00:21	02:25	05:42
137	BEDROOM	100	9.9			1263			00:21	00:48	00:00
138	BEDROOM	100	7.1			1339			00:17	00:00	00:00
139	L/K/D	200	69.1		92.1	3264	2892	2565	00:38	02:29	05:42
140	BEDROOM	100	100.0			3086			00:23	01:57	05:25
141	L/K/D	200	100.0		100.0	3734	3525	3303	00:39	02:46	08:02

Table 84: Assessment Data


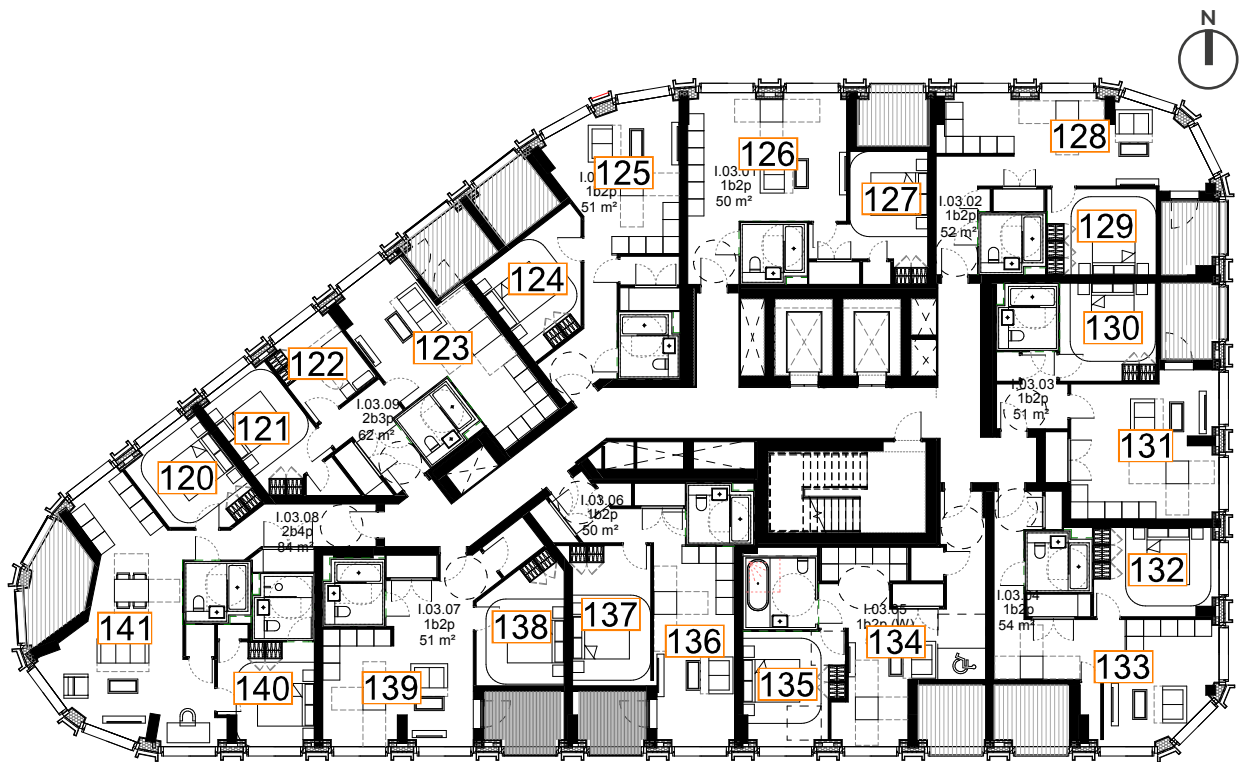


Fig. 94: Floor Plan

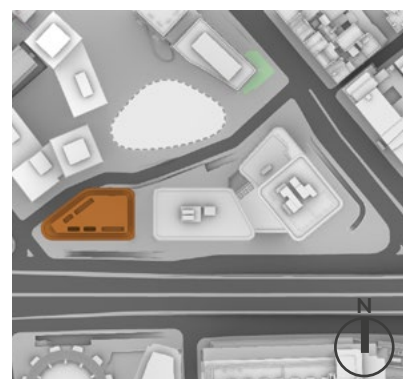

Block I–Level 07

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 07									
142	BEDROOM	100	100.0			3726			00:00	00:00	01:10
143	BEDROOM	100	100.0			3662			00:00	00:00	01:10
144	BEDROOM	100	100.0			3835			00:00	00:00	01:10
145	L/K/D	200	36.2		56.6	3003	2379	1746	00:00	00:00	01:10
146	BEDROOM	100	13.3			701			00:00	00:00	00:00
147	L/K/D	200	39.7		48.1	2858	2101	1540	00:00	00:00	00:23
148	L/K/D	200	18.3		27.4	1967	1280	707	00:00	00:00	00:00
149	BEDROOM	100	0.0			44			00:00	00:00	00:00
150	L/K/D	200	55.0		80.6	3202	2731	2291	00:00	00:00	00:00
151	BEDROOM	100	0.0			113			00:00	00:00	00:00
152	BEDROOM	100	0.0			107			00:04	00:00	00:00
153	L/K/D	200	1.5		3.0	1475	1007	597	00:50	01:43	01:32
154	BEDROOM	100	31.3			1859			00:23	02:15	02:15
155	L/K/D	200	75.1		92.6	3638	3404	3123	01:14	04:27	07:33
156	L/K/D	200	24.4		30.9	2337	1855	1486	00:41	03:25	06:04
157	BEDROOM	100	100.0			3162			00:31	03:19	06:02
158	L/K/D	200	28.9		37.4	2213	1713	1371	00:32	03:15	06:02
159	BEDROOM	100	11.6			1349			00:26	00:50	00:00
160	BEDROOM	100	10.7			1416			00:24	00:06	00:00
161	L/K/D	200	75.8		98.5	3336	2986	2660	00:53	03:22	06:02
162	BEDROOM	100	100.0			3131			00:38	02:53	05:45
163	L/K/D	200	100.0		100.0	3763	3576	3356	01:00	03:52	08:20

Table 85: Assessment Data


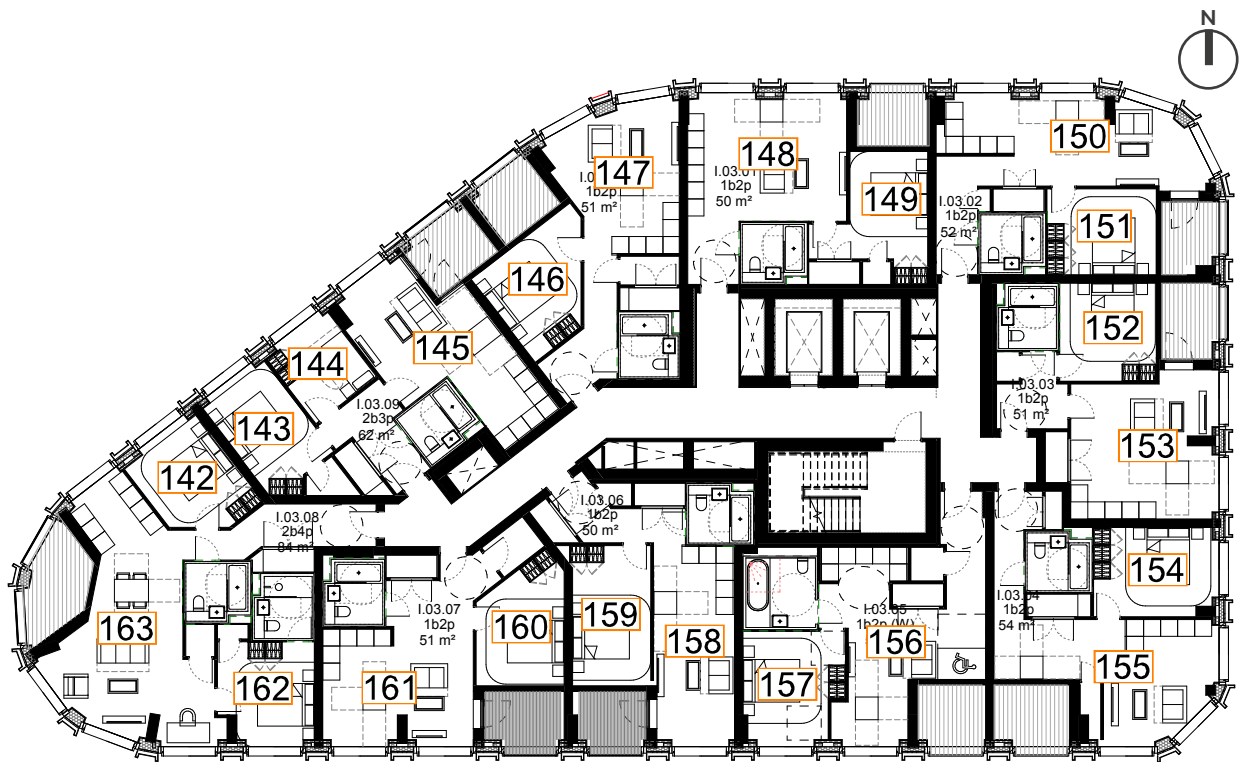


Fig. 95: Floor Plan

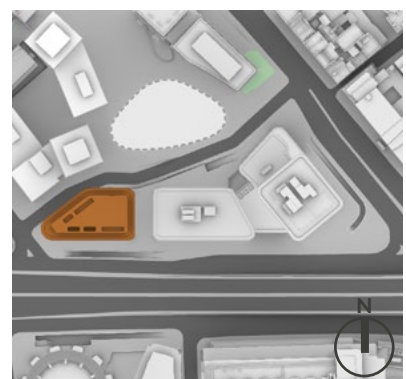


Block I–Level 08

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 08									
164	BEDROOM	100	100.0			3760			00:00	00:00	01:10
165	BEDROOM	100	100.0			3724			00:00	00:00	01:10
166	BEDROOM	100	100.0			3875			00:00	00:00	01:10
167	L/K/D	200	48.8		64.3	3175	2667	2152	00:00	00:00	01:10
168	BEDROOM	100	25.6			1089			00:00	00:00	00:00
169	L/K/D	200	62.5		73.4	3496	3159	2769	00:00	00:00	00:23
170	L/K/D	200	33.8		49.5	2878	2168	1629	00:00	00:00	00:00
171	BEDROOM	100	0.0			239			00:00	00:00	00:00
172	L/K/D	200	73.4		95.2	3346	2954	2579	00:00	00:00	00:00
173	BEDROOM	100	0.0			142			00:00	00:00	00:00
174	BEDROOM	100	0.0			133			00:04	00:00	00:00
175	L/K/D	200	2.2		4.3	1604	1102	658	01:14	01:43	01:32
176	BEDROOM	100	36.1			1993			01:05	02:15	02:15
177	L/K/D	200	80.9		93.7	3673	3455	3181	01:57	05:18	07:52
178	L/K/D	200	25.2		35.3	2418	1922	1589	01:06	04:39	06:19
179	BEDROOM	100	100.0			3226			00:56	04:26	06:18
180	L/K/D	200	31.3		39.6	2307	1796	1484	00:52	04:12	06:17
181	BEDROOM	100	14.9			1430			00:35	00:50	00:00
182	BEDROOM	100	12.9			1500			00:33	00:06	00:00
183	L/K/D	200	82.8		99.4	3391	3046	2753	01:07	04:15	06:16
184	BEDROOM	100	100.0			3187			00:50	03:45	06:03
185	L/K/D	200	100.0		100.0	3787	3594	3394	01:10	04:38	08:34

Table 86: Assessment Data



Fig. 96: Floor Plan

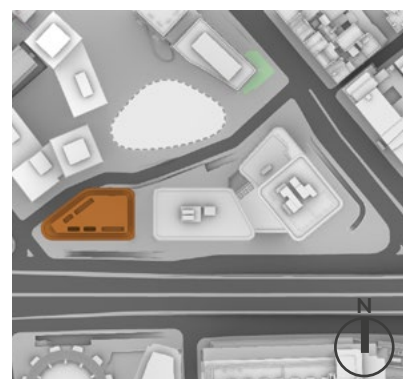

Block I–Level 09

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 09									
186	BEDROOM	100	100.0			3783			00:00	00:00	01:10
187	BEDROOM	100	100.0			3744			00:00	00:00	01:10
188	BEDROOM	100	100.0			3900			00:00	00:00	01:10
189	L/K/D	200	56.6		69.5	3241	2794	2313	00:00	00:00	01:10
190	BEDROOM	100	37.0			1735			00:00	00:00	00:00
191	L/K/D	200	82.9		97.8	3665	3413	3158	00:00	00:00	00:23
192	L/K/D	200	49.5		69.2	3191	2703	2184	00:00	00:00	00:00
193	BEDROOM	100	4.5			618			00:00	00:00	00:00
194	L/K/D	200	90.2		99.0	3442	3081	2742	00:00	00:00	00:00
195	BEDROOM	100	0.0			157			00:00	00:00	00:00
196	BEDROOM	100	0.0			146			00:04	00:00	00:00
197	L/K/D	200	2.6		6.1	1696	1173	800	01:40	01:43	01:32
198	BEDROOM	100	43.5			2113			01:34	02:16	02:15
199	L/K/D	200	87.2		95.1	3707	3487	3248	02:40	05:28	07:55
200	L/K/D	200	26.2		37.9	2492	2028	1668	01:51	04:50	06:20
201	BEDROOM	100	100.0			3296			01:35	04:47	06:19
202	L/K/D	200	33.4		41.7	2388	1883	1600	01:26	04:43	06:19
203	BEDROOM	100	17.8			1520			00:46	00:50	00:00
204	BEDROOM	100	16.0			1593			00:37	00:06	00:00
205	L/K/D	200	88.6		100.0	3450	3099	2820	01:21	04:46	06:25
206	BEDROOM	100	100.0			3239			01:02	04:22	06:17
207	L/K/D	200	100.0		100.0	3807	3609	3429	01:22	05:18	08:36

Table 87: Assessment Data

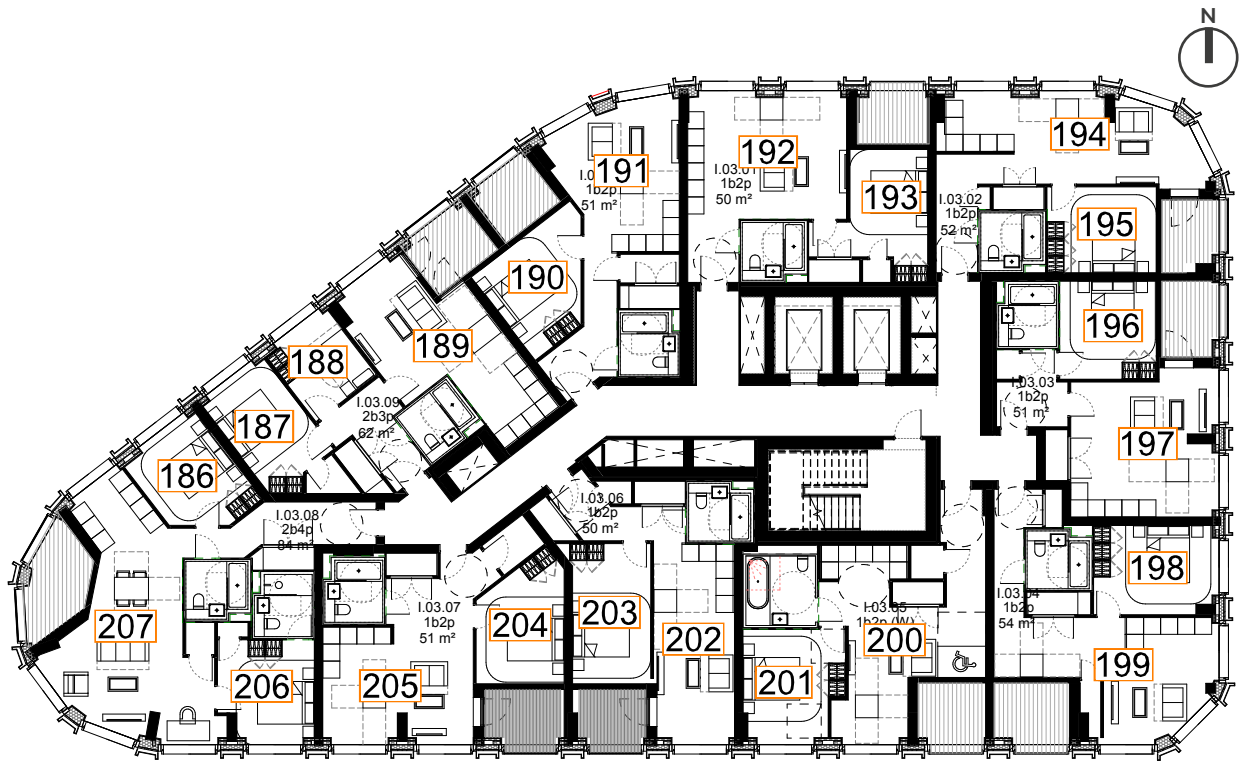


Fig. 97: Floor Plan



Block I–Level 10

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 10									
208	BEDROOM	100	100.0			3798			00:00	00:00	01:10
209	BEDROOM	100	100.0			3763			00:00	00:00	01:10
210	BEDROOM	100	100.0			3917			00:00	00:00	01:10
211	L/K/D	200	59.9		71.4	3306	2891	2456	00:00	00:00	01:10
212	BEDROOM	100	42.7			2027			00:00	00:00	00:00
213	L/K/D	200	97.8		99.7	3739	3512	3289	00:00	00:00	00:23
214	L/K/D	200	64.1		89.0	3343	2938	2535	00:00	00:00	00:00
215	BEDROOM	100	9.7			1002			00:00	00:00	00:00
216	L/K/D	200	97.1		100.0	3494	3165	2877	00:00	00:00	00:00
217	BEDROOM	100	0.0			183			00:00	00:00	00:00
218	BEDROOM	100	0.0			163			00:04	00:00	00:00
219	L/K/D	200	2.8		9.1	1867	1290	923	01:51	01:43	01:32
220	BEDROOM	100	48.7			2203			01:56	02:17	02:15
221	L/K/D	200	90.9		96.7	3727	3509	3306	03:35	05:40	07:56
222	L/K/D	200	28.6		43.4	2598	2104	1792	02:33	05:01	06:20
223	BEDROOM	100	100.0			3350			02:18	04:58	06:20
224	L/K/D	200	35.6		44.7	2455	2004	1684	02:12	04:56	06:20
225	BEDROOM	100	21.9			1599			01:08	00:50	00:00
226	BEDROOM	100	19.1			1697			00:37	00:06	00:00
227	L/K/D	200	95.6		100.0	3482	3131	2888	02:09	04:58	06:28
228	BEDROOM	100	100.0			3303			01:34	04:34	06:20
229	L/K/D	200	100.0		100.0	3817	3619	3461	01:49	05:40	08:38

Table 88: Assessment Data


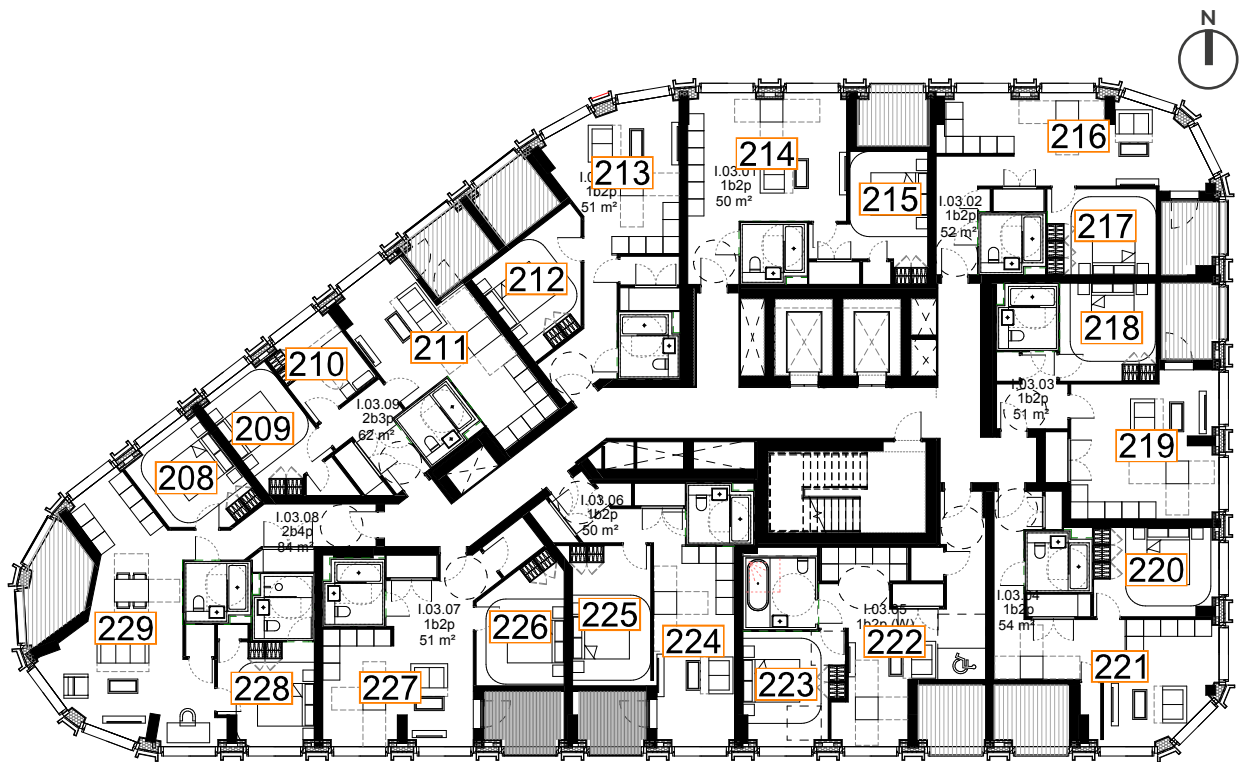


Fig. 98: Floor Plan

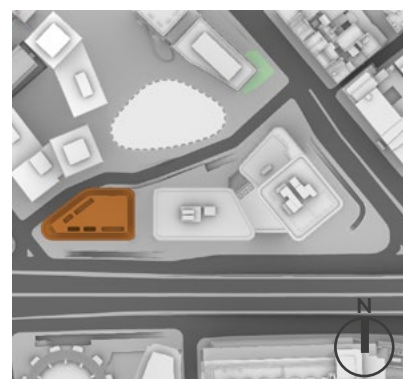

Block I–Level 11

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 11									
230	BEDROOM	100	100.0			3811			00:00	00:00	01:10
231	BEDROOM	100	100.0			3777			00:00	00:00	01:10
232	BEDROOM	100	100.0			3930			00:00	00:00	01:10
233	L/K/D	200	61.7		73.9	3348	2940	2529	00:00	00:00	01:10
234	BEDROOM	100	47.9			2136			00:00	00:00	00:00
235	L/K/D	200	99.2		100.0	3778	3578	3352	00:00	00:00	00:23
236	L/K/D	200	80.5		96.6	3419	3055	2710	00:00	00:00	00:00
237	BEDROOM	100	15.3			1252			00:00	00:00	00:00
238	L/K/D	200	98.6		100.0	3552	3246	2957	00:00	00:00	00:00
239	BEDROOM	100	0.0			241			00:00	00:00	00:00
240	BEDROOM	100	0.0			204			00:04	00:00	00:00
241	L/K/D	200	3.9		12.0	2007	1387	1080	01:51	01:43	01:30
242	BEDROOM	100	56.1			2293			02:05	02:18	02:15
243	L/K/D	200	94.0		98.6	3739	3549	3357	04:22	05:53	07:57
244	L/K/D	200	31.4		49.1	2706	2217	1883	03:40	05:15	06:23
245	BEDROOM	100	100.0			3408			03:25	05:14	06:22
246	L/K/D	200	37.7		46.8	2589	2089	1774	03:18	05:21	06:22
247	BEDROOM	100	24.8			1685			01:26	00:50	00:00
248	BEDROOM	100	22.7			1804			00:37	00:06	00:00
249	L/K/D	200	98.0		100.0	3525	3188	2963	02:59	05:35	06:29
250	BEDROOM	100	100.0			3376			02:24	05:16	06:21
251	L/K/D	200	100.0		100.0	3826	3640	3491	02:47	06:14	08:39

Table 89: Assessment Data

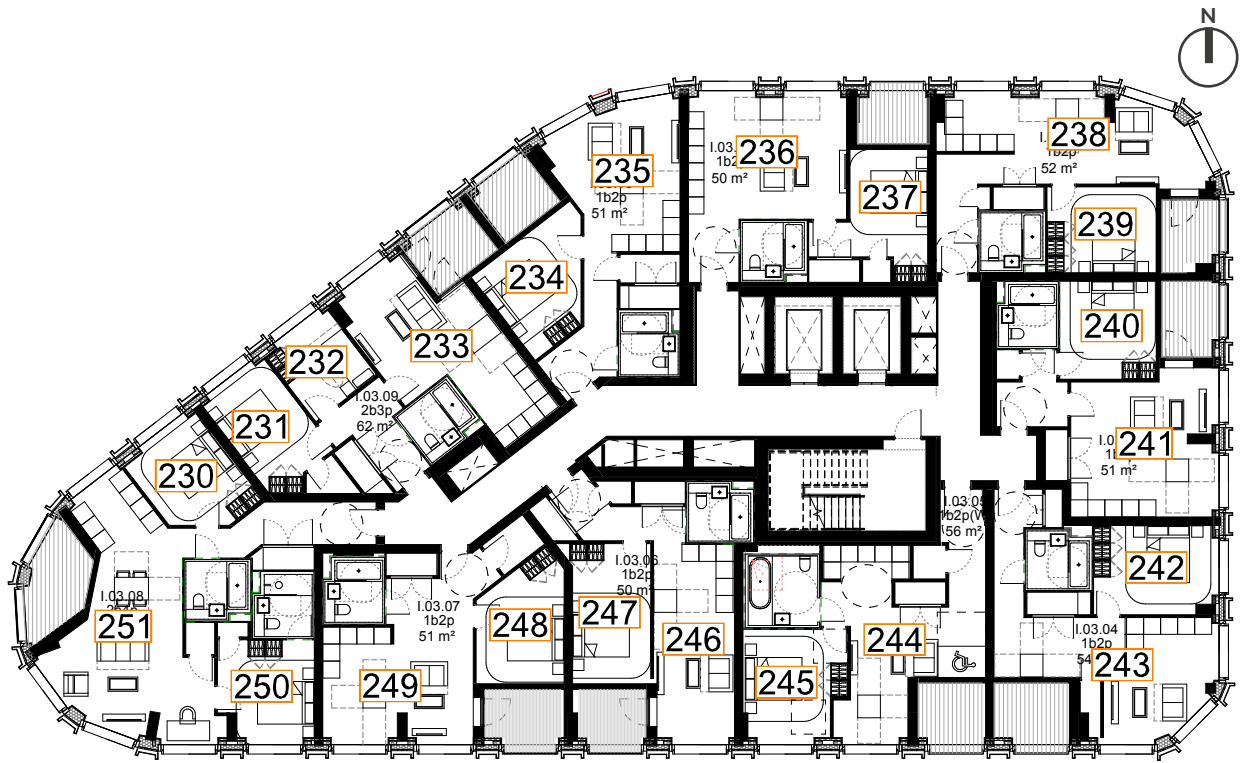


Fig. 99: Floor Plan



Block I–Level 12

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 12									
252	BEDROOM	100	100.0			3817			00:00	00:00	01:10
253	BEDROOM	100	100.0			3790			00:00	00:00	01:10
254	BEDROOM	100	100.0			3956			00:00	00:00	01:10
255	L/K/D	200	62.9		75.1	3382	2999	2609	00:00	00:00	01:10
256	BEDROOM	100	51.7			2241			00:00	00:00	00:00
257	L/K/D	200	99.7		100.0	3806	3603	3403	00:00	00:00	00:23
258	L/K/D	200	87.7		98.3	3474	3132	2798	00:00	00:00	00:00
259	BEDROOM	100	18.8			1465			00:00	00:00	00:00
260	L/K/D	200	99.8		100.0	3602	3309	3029	00:00	00:00	00:00
261	BEDROOM	100	0.0			395			00:00	00:00	00:00
262	BEDROOM	100	0.0			269			00:04	00:00	00:00
263	L/K/D	200	9.1		17.8	2144	1507	1172	01:51	01:42	01:32
264	BEDROOM	100	64.3			2404			02:15	02:23	02:14
265	L/K/D	200	95.3		99.3	3754	3590	3407	04:43	06:02	07:59
266	L/K/D	200	34.5		56.6	2795	2308	1945	04:37	05:31	06:23
267	BEDROOM	100	100.0			3455			04:23	05:30	06:24
268	L/K/D	200	40.9		48.7	2669	2171	1854	04:19	05:27	06:23
269	BEDROOM	100	27.7			1769			01:42	00:50	00:00
270	BEDROOM	100	27.6			1917			00:38	00:06	00:00
271	L/K/D	200	98.8		100.0	3563	3242	3019	04:17	05:38	06:31
272	BEDROOM	100	100.0			3422			03:34	05:22	06:23
273	L/K/D	200	100.0		100.0	3836	3660	3510	04:00	06:21	08:40

Table 90: Assessment Data


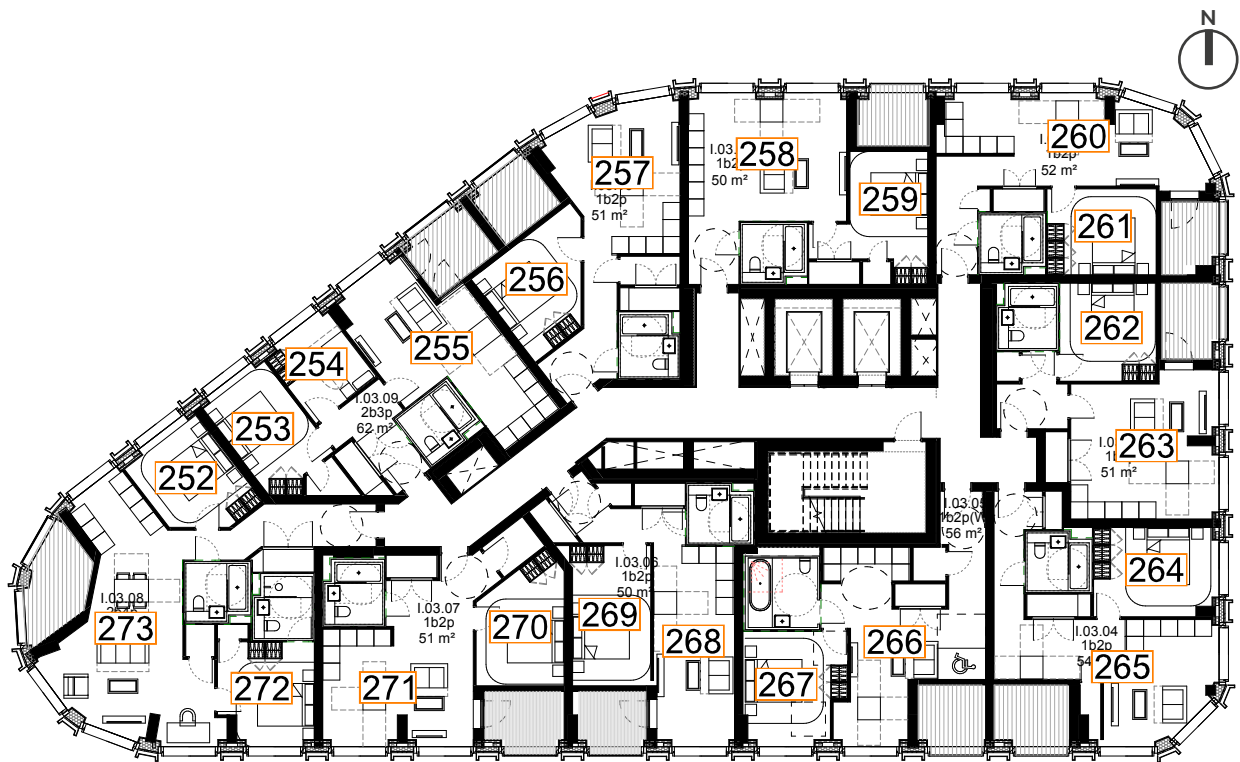


Fig. 100: Floor Plan

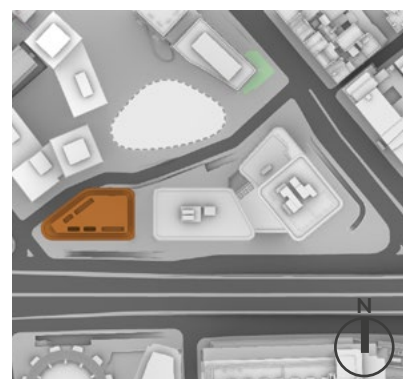

Block I–Level 13

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I - LEVEL 13									
274	BEDROOM	100	100.0			3822			00:00	00:00	01:10
275	BEDROOM	100	100.0			3792			00:00	00:00	01:10
276	BEDROOM	100	100.0			3965			00:00	00:00	01:10
277	L/K/D	200	64.1		77.5	3413	3046	2668	00:00	00:00	01:10
278	BEDROOM	100	54.5			2305			00:00	00:00	00:00
279	L/K/D	200	100.0		100.0	3817	3618	3432	00:00	00:00	00:23
280	L/K/D	200	92.4		99.4	3506	3182	2875	00:00	00:00	00:00
281	BEDROOM	100	23.3			1585			00:00	00:00	00:00
282	L/K/D	200	100.0		100.0	3619	3356	3108	00:00	00:00	00:01
283	BEDROOM	100	0.0			665			00:00	00:00	00:00
284	BEDROOM	100	0.0			442			00:04	00:00	00:00
285	L/K/D	200	17.8		29.6	2369	1733	1372	01:51	01:42	01:29
286	BEDROOM	100	79.1			2572			02:26	02:29	02:14
287	L/K/D	200	96.7		99.5	3781	3618	3457	05:04	06:09	08:00
288	L/K/D	200	37.7		63.6	2846	2376	1995	04:51	05:35	06:25
289	BEDROOM	100	100.0			3480			04:39	05:35	06:24
290	L/K/D	200	42.5		52.7	2781	2294	1937	04:37	05:33	06:25
291	BEDROOM	100	32.6			1842			01:42	00:50	00:00
292	BEDROOM	100	32.0			1998			00:44	00:06	00:00
293	L/K/D	200	100.0		100.0	3594	3297	3063	04:46	05:46	06:32
294	BEDROOM	100	100.0			3467			04:28	05:32	06:24
295	L/K/D	200	100.0		100.0	3852	3691	3545	04:50	06:29	08:42

Table 91: Assessment Data

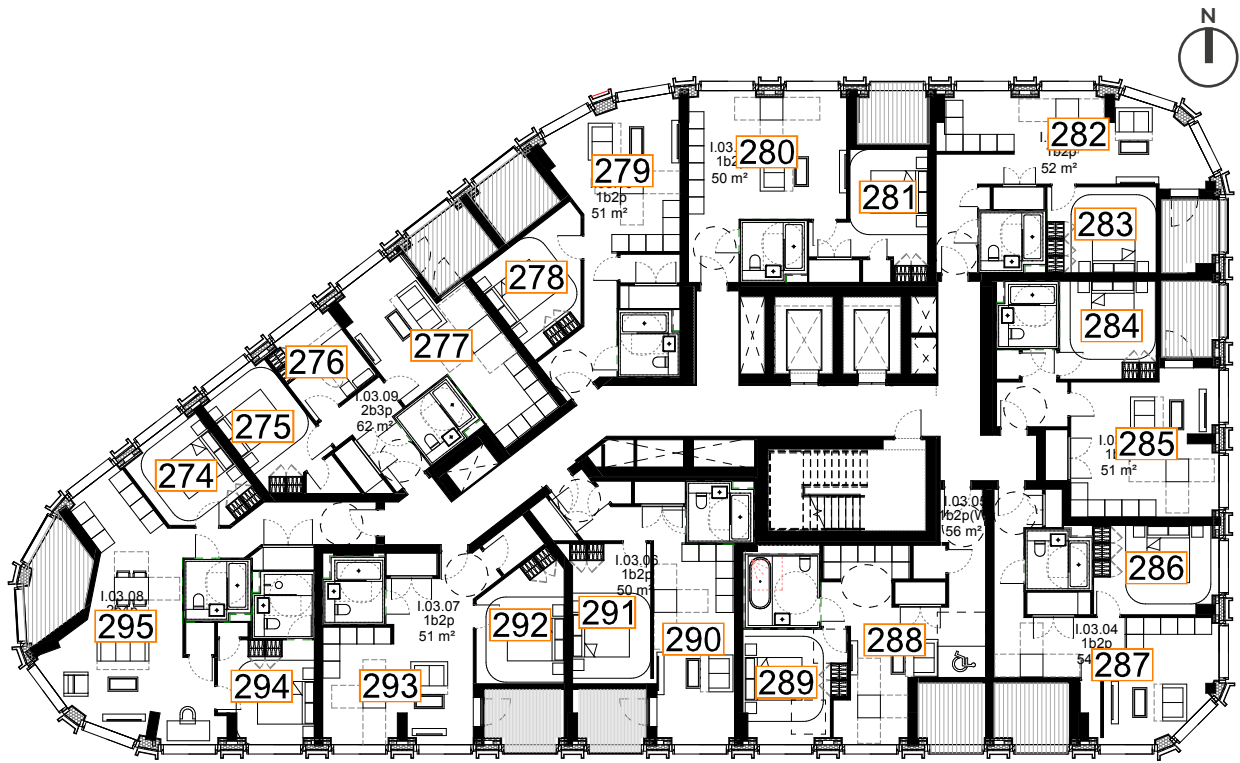


Fig. 101: Floor Plan



Block I–Level 14

		DAYLIGHT							SUNLIGHT		
ROOM REF.	ROOM USE	EN SPATIAL DAYLIGHT AUTONOMY percentage of room achieving target illuminance for 2190 hrs (50% of daylight hours) Weather File: GBR_Gatwick				EN DAYLIGHT AUTONOMY hours at which the target illuminance is achieved across 50% of room (2190 hrs target) Weather File: GBR_Gatwick			HOURS:MIN		
		TARGET	RELEVANT ENSDA	100	150	100	150	200	1 FEB	25 FEB	21 MAR
		BLOCK I – LEVEL 14									
296	BEDROOM	100	100.0			3808			00:00	00:00	01:10
297	BEDROOM	100	100.0			3609			00:00	00:00	01:10
298	BEDROOM	100	100.0			3756			00:00	00:00	01:10
299	L/K/D	200	63.4		100.0	3258	2826	2380	00:00	00:00	01:10
300	BEDROOM	100	78.2			2376			00:00	00:00	00:00
301	L/K/D	200	100.0		100.0	3808	3609	3407	00:00	00:00	00:23
302	BEDROOM	100	100.0			3264			00:00	00:00	00:00
303	BEDROOM	100	100.0			3164			00:00	00:00	00:00
304	L/K/D	200	99.1		100.0	3601	3314	3035	00:00	00:27	00:30
305	BEDROOM	100	0.0			517			00:00	00:00	00:00
306	BEDROOM	100	0.0			568			00:18	00:00	00:00
307	L/K/D	200	41.3		59.6	2902	2378	1998	01:51	01:41	01:52
308	BEDROOM	100	66.9			2589			02:26	02:29	02:13
309	BEDROOM	100	100.0			3975			05:11	06:22	08:01
310	BEDROOM	100	100.0			3630			05:00	05:48	06:27
311	L/K/D	200	71.1		83.8	3305	2961	2651	05:17	06:08	06:34
312	BEDROOM	100	10.1			1707			00:57	00:00	00:00
313	BEDROOM	100	16.7			1765			00:11	00:00	00:00
314	L/K/D	200	79.8		98.0	3296	2957	2645	05:07	05:58	06:34
315	BEDROOM	100	100.0			3301			04:52	05:45	06:26
316	BEDROOM	100	100.0			3397			04:53	05:44	06:26
317	BEDROOM	100	100.0			3459			04:50	05:46	06:25
318	L/K/D	200	100.0		100.0	3809	3619	3444	05:40	06:49	08:43

Table 92: Assessment Data